


Standard Name 2 of 10  
NCS 7015-R90B matt

Batch Name 49 of 49  
Varpsatin A

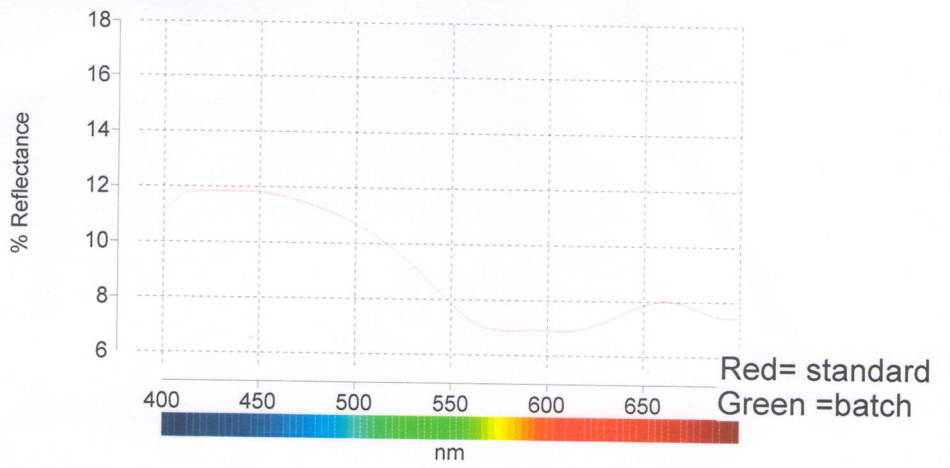

**Pass** Batch is: L lighter  
CMC DE = 0.66 C more saturated  
h more red


	Standard	Batch	Delta
L*	34.80	35.64	0.48
C*	10.32	10.87	0.45
h*	256.11	256.44	0.07
DE			0.66

III/Obs	DL*	Da*	Db*	DC*	DH*	DE*	Standard	Batch
D65 10 Deg	0.84	-0.07	-0.55	0.55	0.06	0.66		
A 10 Deg	0.81	-0.68	-0.54	0.74	-0.45	0.89		
msTL84-10	0.82	-1.23	-0.57	0.80	-1.09	1.52		

Today's Date:  
20-Feb-12

Standard Name 2 of 10  
 NCS 7015-R90B matt

Batch Name 48 of 48  
 Varpsatin B

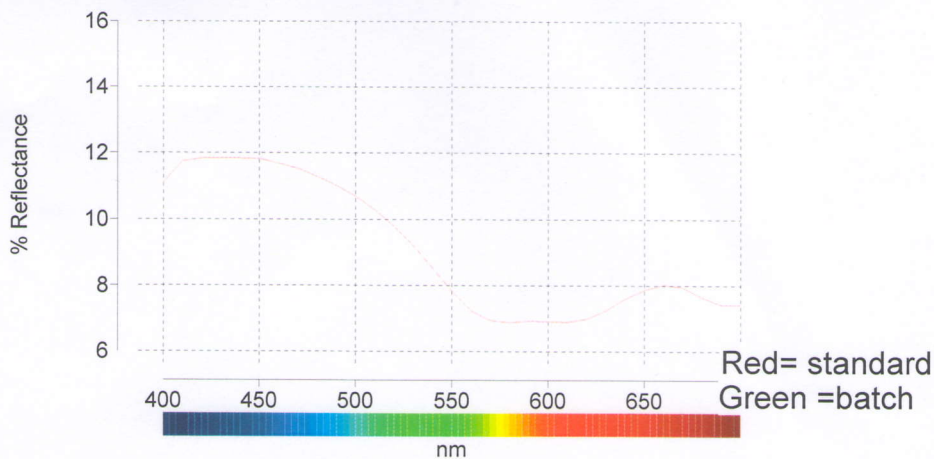

**Pass** Batch is: L darker  
 CMC DE = 0.59 C more saturated  
 h more red

	Standard	Batch	Delta
L*	34.80	34.80	-0.01
C*	10.32	10.97	0.53
h*	256.11	257.22	0.25
DE			0.59

Ill/Obs	DL*	Da*	Db*	DC*	DH*	DE*	Standard	Batch
D65 10 Deg	-0.01	0.05	-0.68	0.65	0.21	0.59		
A 10 Deg	-0.04	-0.60	-0.66	0.82	-0.34	0.74		
msTL84-10	-0.02	-1.10	-0.70	0.90	-0.94	1.33		

Today's Date:  
 20-Feb-12